




How to Recover the Meter from Firmware Update Failure

Items Required:

- AcuvimII meter to recover
- AcuvimII meter firmware update software (USProgram)
- AcuvimII meter firmware (.bin file/.abin file)
- RS485-USB converter cable

Procedure

1. Open USProgram.exe and load firmware file into the software.

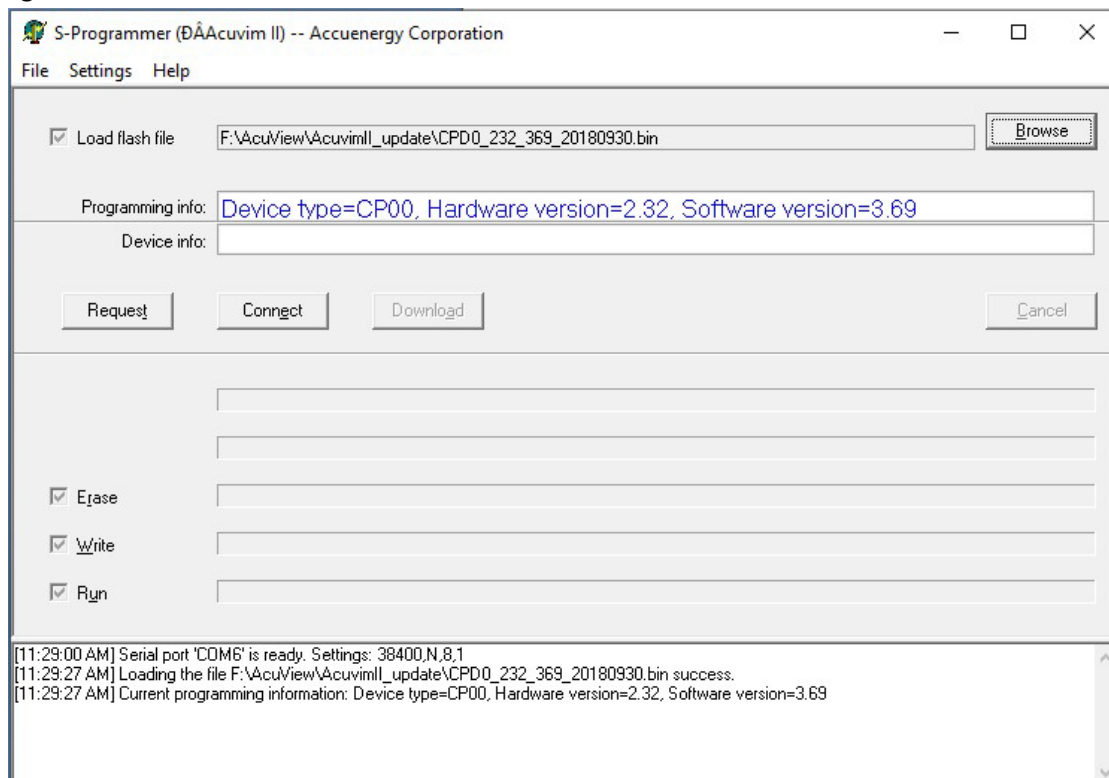



2. Press the H, P, E buttons on meter at same time.



3. Power on the meter while continuing to hold the buttons for 5 seconds after supplying power to the meter.

4. Next, click the “Connect” button on the software program. After clicking the “Connect” button users should see the “Device Info” field populated.

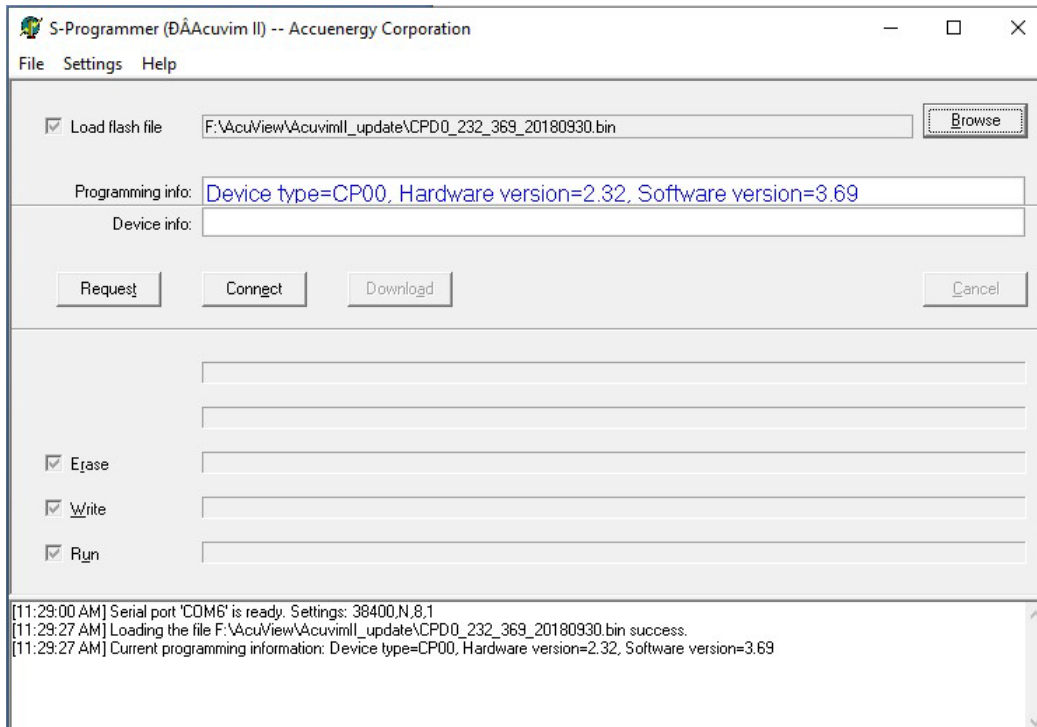

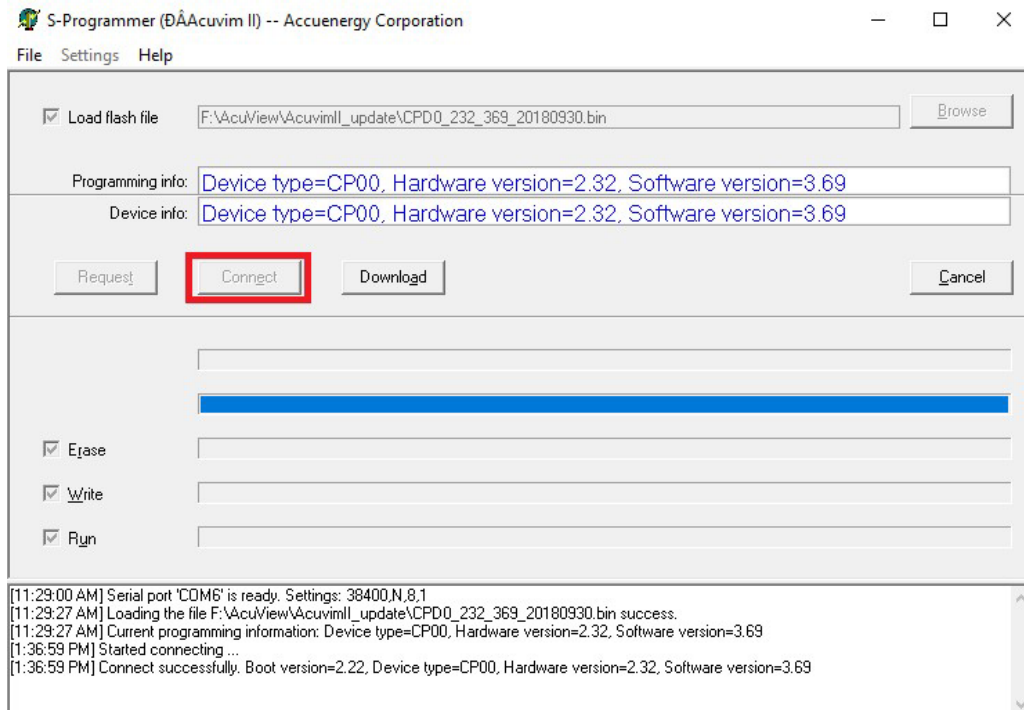

5. Click “Download” to begin the firmware update. It should take roughly 3-4 minutes to complete.

